



1

FM Wind Uplift Design Resources

- www.roofnav.com
- FM PLPDS 1-28
- FM PLPDS 1-29
- ASCE 7 2005
- ASCE 7 2016



**FM Global
Property Loss Prevention Data Sheets** **1-28**
October 2015
Interim Revision February 2020
Page 1 of 100
WIND DESIGN

**FM Global
Property Loss Prevention Data Sheets** **1-29**
January 2016
Interim Revision February 2020
Page 1 of 50
ROOF DECK SECUREMENT AND ABOVE-DECK ROOF COMPONENTS

AMERICAN SOCIETY OF CIVIL ENGINEERS
**Minimum Design Loads
for Buildings and
Other Structures**
ASCE 7-16
ASCE

2

FM PLPDS 1-28

FM Insured Building's pressures should be determined by using Rating Calculator on FM RoofNav Website www.roofnav.com

Note that this is not part of the building code and is not a consensus standard

- Calculations Formula based on ASCE 7-05
- Wind Map based on ASCE 7-05 (100-yr MRI)
- Results are Allowable Stress Design (ASD)
- Safety Factor x2
- GCp based on ASCE 7-16
- Roof Zones based on ASCE 7-16


3

Wind Uplift Load Determination Key Factors

- Building Height
- Building Location (Local Wind Speed)
- Exposure Category (B, C, or D)
- Importance Category III/IV
- Openings (Partial or Enclosed)



4

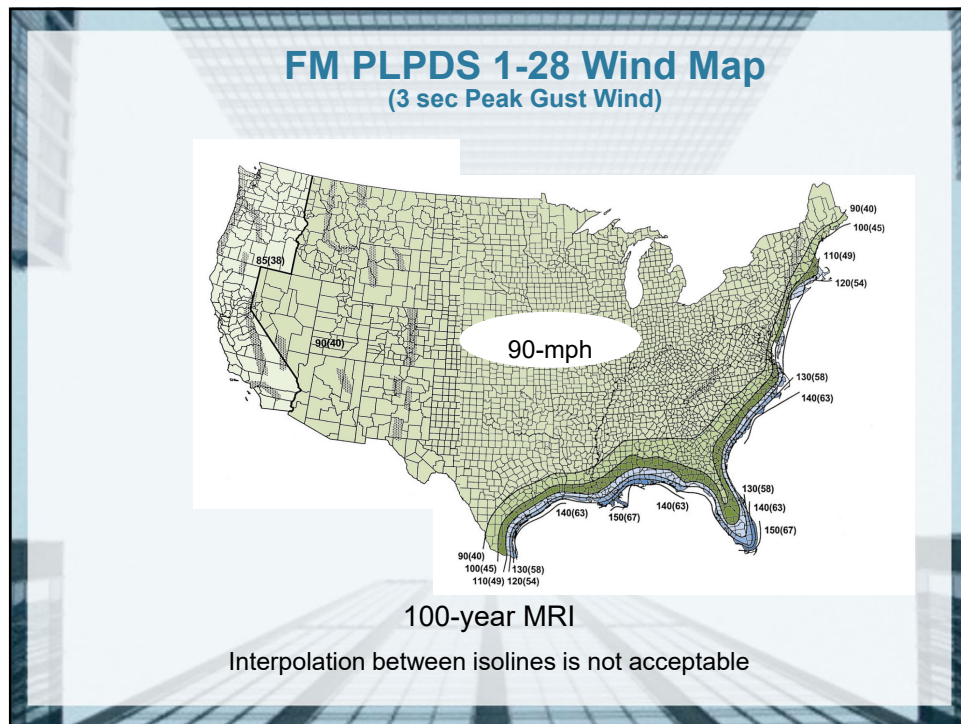

5

Importance Categories (Building Use)

Importance Category I – Low risk to human life (Agricultural or storage)

Importance Category II – Not I, III, & IV (Commercial Buildings)

Importance Category III/IV – Substantial risk to human life (Schools, Public Buildings, Hospitals, Power Plants, etc.)

Importance Factor I = 1.15

6

ASCE 7-05

Velocity Pressure Formula

$$q_z = 0.00256 \times K_z \times K_{zt} \times K_d \times V^2 \times I$$

Variable	Building	ASCE 7-05
K _z	Height & Terrain (40' Exp C)	1.04
K _{zt}	Topography	1
K _d	Wind Directionality	0.85
V	100-yr MRI Winds	90 mph
I	Importance Cat III/IV	1.15
q _z	Results	21.08

$$P = q_z \{ GC_p - GC_{pi} \}$$

7

ASCE 7-16

Roof Zone GC_p Coefficients

Roof Zones for Bldgs. < 90'	ASCE 7-16 GC _p Coefficient	Roof Zones for Bldgs. ≥ 90'	ASCE 7-16 GC _p Coefficient
Zone 1'	0.9	Zone 1'	N/A
Zone 1	1.7	Zone 1	1.4
Zone 2	2.3	Zone 2	2.3
Zone 3	3.0	Zone 3	3.0

8

Factory Mutual's Adaptation of ASCE 7-16

GCpi = internal pressure coefficient

Opening Types	Amount of Openings	ASCE 7-16 GCpi Coefficient
Enclosed	Less than 10%	.18
Partially Enclosed	10% or greater openings	.55

$$P = qz (GCp - GCpi) \cdot SF$$

Roof Area	qz	GCp	GCpi	Safety Factor	Result (lbs/sqft)	FM Rating
Zone 1'	21.08	-0.9	0.18	2	-45.5	60
Zone 1	21.08	-1.7	0.18	2	-79.3	90
Zone 2	21.08	-2.3	0.18	2	-104.6	105
Zone 3	21.08	-3.0	0.18	2	-142.5	150

9

Example Results ASCE 7-05 & ASCE 7-16 vs. FM 1-28

Charlotte, NC

	ASCE 7-05	ASCE 7-16	FM PLPDS 1-28
40-ft high			
Exposure "C"			
Enclosed Bldg			
Category IV			
Local Wind Speed	90 mph	124 mph	90 mph
Zone 1'	N/A	21 psf	60 psf
Zone 1	25 psf	39 psf	90 psf
Zone 2	42 psf	52 psf	105 psf
Zone 3	63 psf	71 psf	150 psf

10

FM PLPDS 1-29


This is not part of the building code and is not a consensus standard, nor has it been adopted by the Florida Building Code

- Prescriptive Criteria is based on Zone 1, not Zone 1'
- Prescriptive Criteria Limitations:
 - Zone 1 Rating $\leq$ 1-90 (90-psf)
 - Zone 1 Rating $\leq$ 1-105 (105-psf) and in a Non-Tropical Cyclone-Prone Region
- Prescriptive enhancements redefined
 - Insulation securement for adhered roof covers:
 - Fasteners & Adhesives
 - Roof cover securement for mechanically attached roof covers:
 - Linear in-seam
 - Induction Welded


11

Roof Zone Layout

h = roof height (ft)

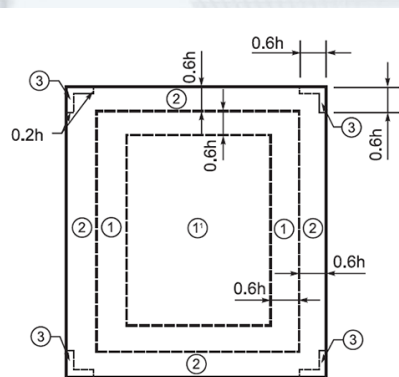

$h < 90'$

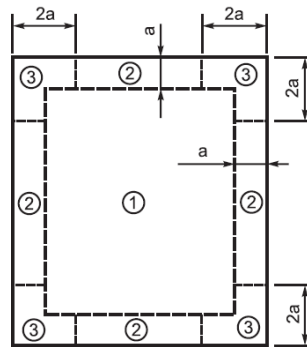

$a = 10\%$ of the lesser horizontal dimension, but not less than 3ft. (0.9m)

$h \geq 90'$

12




Adhered Membrane Prescriptive Enhancement Fastened Insulation

Zone 2: 50% more fasteners and plates than the field, but not less than 1 fastener 2 ft^2 and not more than 1 fastener per 1 ft^2

Zone 3: 1 fastener per 1 ft^2

Example

Zone 1: 8 per $4' \times 8'$ board (1 fastener per 4 ft^2)
 Zone 2: The larger of +50% of 8 per board (12) or 1 fastener per 2 ft^2 (16)
 Zone 3: 1 fastener per 1 ft^2 (32)

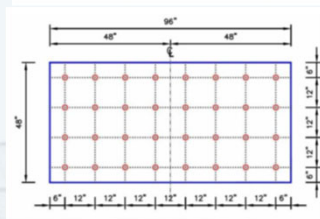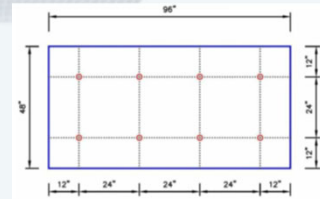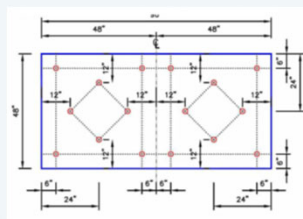

13


Adhered Membrane Prescriptive Enhancement Adhesive Ribbon Spacing

Adhered membrane with substrate adhered in ribbons

Zone 2: 67% closer ribbons spacing than the field (rounded down)

Zone 3: 50% closer ribbon spacing than the field (rounded down)

Example: Zone 1: 12 inches, Zone 2: 8 inches, Zone 3: 6 inches

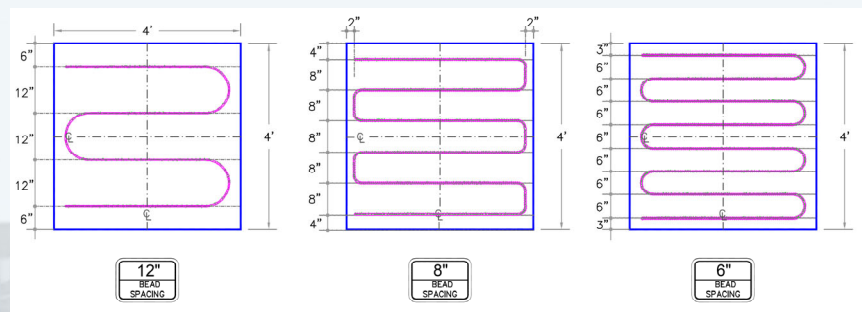


14

Mechanically Fastened Membrane Prescriptive Enhancements Zone 2 and Zone 3 – In-Seam Attachment Option 1

Zone 2: Row spacing no greater than 67% of the field rows

Zone 3: Row spacing no greater than 50% of the field rows

Example: Zone 1: 7.5 ft
Zone 2: $(7.5 \times .67) = 5$ ft
Zone 3: $(7.5 \times .5) = 3.75$ ft

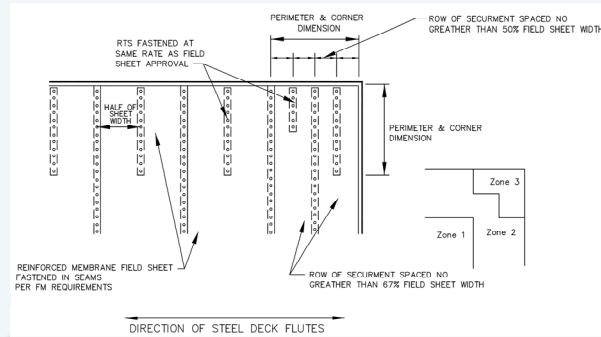

15

Mechanically Fastened Membrane Prescriptive Enhancements Zone 2 and Zone 3 – In-Seam Attachment Option 2

Note: This option is similar to ANSI/SPRI WD-1 & RAS 137

- Determine Zone 1 Pressure and Uplift Rating of assembly
- The sheet width from the Zone 1 assembly is allowed to reduce proportionally to the wind uplift increases in Zone 2 and Zone 3 respectively, rounded up to the nearest 15 PSF

Example: Zone 1 = -80 psf (uplift rating 90 psf)

Zone 1 roof system is 7.5 ft wide rows at 6 inches (0.5 ft) on center

$$[(\text{Zone 1 Rating}) \times (\text{Zone 1 Row})] / (\text{Zone 2 or Zone 3 Rating}) = \text{Zone 2 or Zone 3 Row}$$

Zone 2: Example Results: $(90 \times 7.5) / 105 = 6.43$ ft. rows

Zone 3: Example Results: $(90 \times 7.5) / 150 = 4.5$ ft. rows

16

Mechanically Fastened Membrane Prescriptive Enhancements

Induction Weld

Plate & Fastener Density for Membrane Induction Weld

Zone 2: Reduce fastener contributory area to 67% of Zone 1

Zone 3: Reduce fastener contributory area to 50% of Zone 1

Zone 1 Fastening Rate: 1 fastener per 5.33 sq. ft. = 6 per board

Zone 2 Fastening Rate= $5.33 \times .67 = 3.57$ sq. ft. per fastener
32 sq. ft. per board/ $3.57 = 9$ per board

Zone 3 Fastening Rate= $5.33 \times .5 = 2.67$ sq. ft. per fastener
32 sq. ft. per board/ $2.67 = 12$ per board